



96D Allen Blvd.,  
Farmingdale NY 11735  
TEL: (516)293-8944  
FAX: (516)293-8956

Page 1

Received:	09/16/96	Completed:	09/17/96	Letter:	S	jd	P.O. #:	Test Report #:	2-13332-0-
Client's Identification	Premium Grade Debris Netting								
Tested For: Larry Greenberg Pearlweave Safety Netting, Inc. 606 W 131 Street New York, NY 10027				Key Test: NFPA 701-96 TM#2 Flat				180	
				Tel: 1-(212)-283-0505				Ext:	
				Fax: 1-(212)-862-8951					

TEST PERFORMED: NFPA 701 - Standard Methods of Fire Tests for Flame Resistant Textiles and Films 1996 Edition - Test Method #2 - Flat Sheet Specimens

TESTED:  Initially  After 72 hours water leaching  
 After 3 dry cleanings  After 100 hours accelerated weathering  
 After 5 launderings

RESULTS:

Specimen #	After Flame Seconds	Drip Burn Seconds	Char Length mm
1	0	0	254
2	0	0	292
3	0	0	287
4	0	0	274
5	0	0	287
6	0	0	272
7	0	0	279
8	0	0	284
9	0	0	274
10	0	0	275

APPROXIMATE WEIGHT OF MATERIAL (as measured by Govmark): 163 g/m<sup>2</sup>

REMARKS: All specimens are cut in the length direction. NA = Not available.

CONVERSION FACTORS: mm ÷ 25 = inches g/m<sup>2</sup> ÷ 28.35 x .835 = oz/yd<sup>2</sup>

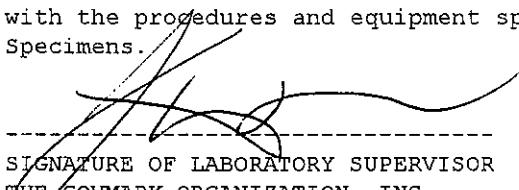
FAILURE CRITERIA: For each individual specimen --

After Flame	Drip Burn	Char Length
Exceeds 2.0 seconds	Exceeds 2.0 seconds	Exceeds 435 mm (17.0")

RETEST PROVISION: Test 5 additional specimens if only 1 specimen fails.

CONCLUSION: Based on the above Results and Failure Criteria, the item tested:  
 Passes;  Fails;  Requires testing of 5 additional specimens

CERTIFICATION: I certify that the above results were obtained after testing specimens in accordance with the procedures and equipment specified by NFPA 701 1996 Edition Test Method #2 Flat Sheet Specimens.

  
SIGNATURE OF LABORATORY SUPERVISOR  
THE GOVMARK ORGANIZATION, INC.